

Operational success story

Casa Pillon

Anno di costruzione (2008), Caldaro (IT)



INFORMAZIONI GENERALI

| | |
|-------------------------|--|
| Proprietario: | Casa privata monofamiliare |
| Architetto: | SOLARRAUM (Bolzano) in collaborazione con Obrist&Partner |
| Studio di architettura: | SOLARRAUM (Bolzano) |
| Utilizzo: | Edificio residenziale (2 adulti, 4 bambini) |
| Superficie*: | 182,88 m ² (sup. lorda) 151,8 m ² (sup. netta riscaldata) 114,1 m ² sup. netta riscaldata calcolata per il calcolo PHPP |
| Volume*: | 600,52m ³ |
| Anno di costruzione: | 2008/09 |
| Costi di costruzione | 255'000.00 € 1'075.00 €/m ² |

*riferita alla metodologia di calcolo della certificazione

ENERGY PERFORMANCE

Tipo di certificazione: CasaClima (certificazione obbligatoria per il calcolo della domanda di riscaldamento): 9,66kWh/m²y standard 'Casa Clima Gold'.

“Consumo di energia termica per il riscaldamento monitorata ca. 10 kWh/m²a inferiore alla domanda di riscaldamento calcolata con PHPP 14kWh/m²a e CasaClima 11 kWh/m²a.

Il risultato conferma non solo una buona progettazione dell'edificio, ma anche un buon lavoro di costruzione. Dall'altro lato è mostrata una corretta gestione della casa, e uso consapevole da parte degli utenti, che risultano ben informati circa il funzionamento della loro casa. Durante il periodo invernale considerato, l'81% di energia elettrica utilizzata è stato adoperata per usi domestici e 19% per gli impianti degli edificio. Il sistema di ventilazione lavora bene con adeguati ricambi d'aria e bassa velocità dell'aria; con basse concentrazioni di CO₂ (il 90% del tempo < 1000 ppm) e un buon recupero di calore. Il comfort igrometrico interno invernale è risultato molto buono, con temperature interne di circa 22°C e con un'umidità relativa compresa tra 30-50% confermano le condizioni ottimali di comfort.”*

Energia primaria: 29.90 kWh/m²a (dati da monitoraggio)

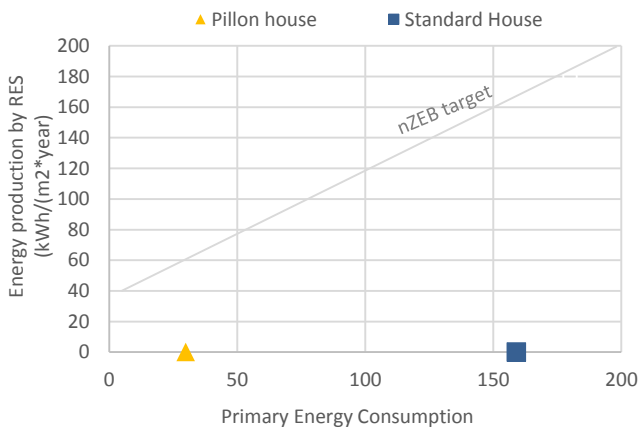



Grafico 1: Bilancio energetico annuale (Fonte: EURAC- ENERBUILD)

*CasaPillon in Caldaro, ha partecipato al progetto all'interno del quale è stata monitorata, da Ottobre 2010 ad Aprile 2011. (Source: H. Mahlknecht, D. Exner, R. Lollini. ENERBUILD - Part B: Analysis of the monitoring data of Passive House "Pillon - Caldaro - Kaltern" Winter report 2011-2012. Eurac research, Institute for Renewable Energy).

DESCRIZIONE DEL CLIMA:

Indirizzo: Caldaro Sulla Strada del Vino, Alto Adige, Italy.
 GPS: Latitude = 46.408, Longitude = 11.235
 Altitudine: 510 m
 Radiazioni Solari annuali: 3,03 kWh/m²*gg (radiazione globale orizzontale media per ogni metro quadro ogni giorno)
 (grafico) 1580 kWh/m² radiazione globale totale anno orizzontale medio per metro quadro (<http://re.jrc.ec.europa.eu/pvgis/apps4/pvest.php>)

HDD20 (<http://www.degreedays.net/>): HDD₂₀= 3131 Bolzano, IT (11.33E,46.46N)
 CDD26 (<http://www.degreedays.net/>): CDD₂₆= 106 Bolzano, IT (11.33E,46.46N)
 HDD20, classificazione italiana: HDD20= 3074 Caldaro, IT (46,4141; 11,2422)
 (DPR 412 del 6/agosto/1993)

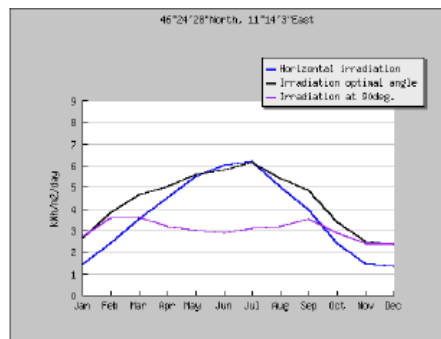

CARATTERISTICHE COSTRUTTIVE DELL'EDIFICIO

1) Involucro edilizio

L'edificio è stato costruito seguendo lo standard casa passiva e certificata con lo standard locale " CasaClima Oro ", il che significa che la domanda di riscaldamento in relazione alla superficie netta di 9,66 kWh / (m² a) .
 0,56/m

Compattezza

(rapporto sup. disperdente/volume riscaldato)

Trasmittanza termica superfici opache:


- Pareti: U value: 0,092 W/m²K
 Il metodo costruttivo in mattoni con sistema di isolamento termico delle pareti esterne, ca. 20 centimetri mattoni Poroton con EPS di 30 cm
- Copertura: U value: 0,103 W/(m²K)
 Il tetto in legno è costruito da travi di legno di 10*30 cm (distanza 1,20 m) più isolante in cellulosa di 30 cm e uno strato esterno in fibra di legno di 12,2 cm
- Solaio controgarage: U value: 0.097 W / (m²K)
 Il Solaio verso garage si compone di soletta di 30 cm cemento, 30 cm EPS più l'usuale costruzione di pavimento

Trasmittanza termica superfici vetrate (U_w)

Triple glazing U_w-value: 0,76 W/(m²K)


- g-value 0.52-0.45
- U_g 0.50 W/(m²K)
- U_f 0.95-1.30 W/(m²K)

F' 0.2h⁻¹ measured air tightness

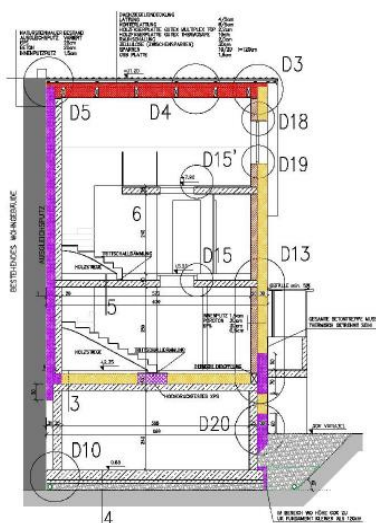

Sezione trasversale

(fonte: Enerbuild, Action 5.4, Part.A)

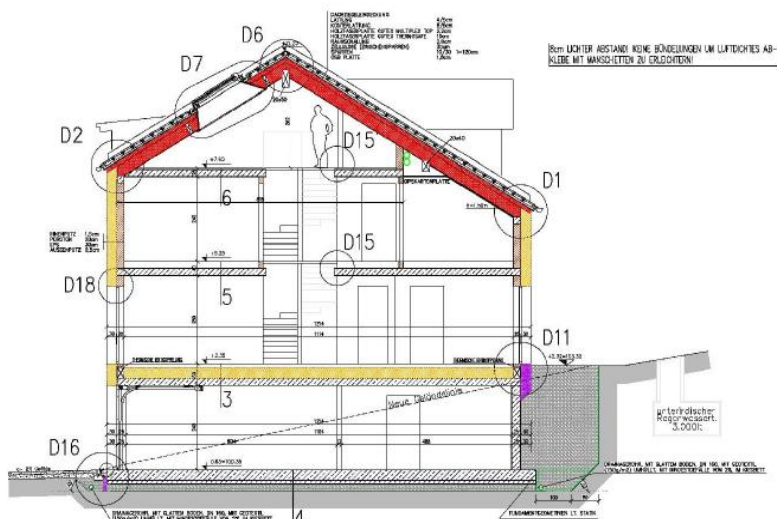

Sezione longitudinale

(fonte: Enerbuild, Action 5.4, Part.A)

2) Sistemi impiantistici

Impianto di riscaldamento Impianto "aerosmart xls" con pompa di calore e geotermia (collettori inerratic di ca. 120 metri di profondità), riscaldamento radiante e riscaldamento ad aria.

Pompa di calore: La pompa di calore comprende queste tre funzioni: l'acqua calda sanitaria, il riscaldamento mediante aria e riscaldamento a pavimento (a bassa temperatura, circa 3 kW). L'unità compatta contiene un sistema di ventilazione con recupero di calore. Alcuni dati tecnici:

- Qualità dell'aria 80 - 235 m³/h
- Portata d'aria 160 m³/h
- Potenza nominale 2700 W
- Efficienza del recuperatore 85 - 93%

Acqua calda sanitaria The steel hot water storage tank has a capacity of 200 liter. The EPS-insulation minimizes the heat losses. The heat transfer from the heat pump is carried out by a double wall condenser. It is also integrated a sacrificial anode and an electric heating element with 2 kW.

Sistema di ventilazione The ventilation units are with constant volume flow DC ventilators with a high efficiency. Heat recovery: to recover the heat from the exhaust air a counter flow plate heat exchanger is used. The fins are out of aluminium with a thickness of 0,1 mm. The container is also out of aluminium.


The ventilators can be controlled regulated at 4 levels:

- Ventilation level 0: Ventilation switched-off
- Ventilation level 1: Lowered air quantity (Level 2 - 30%)
- Ventilation level 2: Nominal air quantity (160 m³/h)
- Ventilation level 3: Increased air quantity (Level 2 + 30%).

The regulation of ventilation levels can be effected manually or automatically. In automatic mode the ventilation levels are regulated by a time switch or by a CO₂ depending regulation. For every day of the week an individual automatic programme is possible. The changing from summer- to wintertime is done automatically. To adapt the system on the building and to balance differences in the channels the nominal air quantity can be adjusted separately in the supply air and exhaust air channels.

Impianto geotermico: (air-brine) 120 running meter surface collector in the underground (-1,8 m) of the backyard.

Energie rinnovabili As both roof surfaces of the saddle roof are north-west and south-east oriented and furthermore the surface of the south-east orientated part is not so big, the building owner decided for efficiency reasons not to put any solar technology on the building at the moment.

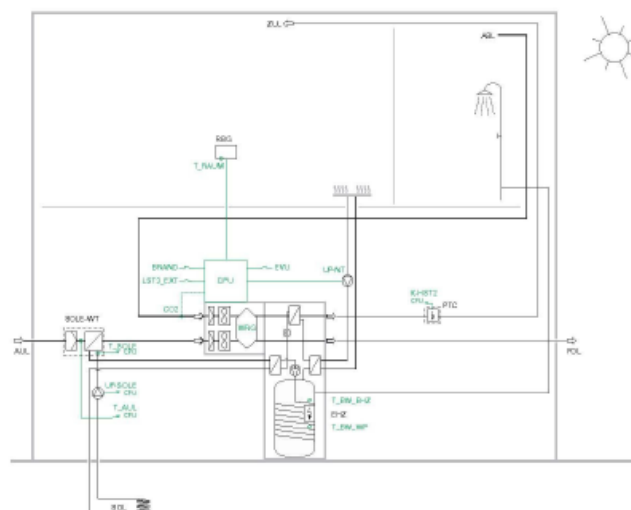

CONTEXT AND HISTORY OF THE BUILDING

2007

Phase of the project assignment

The One-family house is located in a rural area with mainly one-family buildings at the foot of the mountain range „Mendola” nearby the lake of Caldaro south of Bolzano.

Design phase

When the owners decided to build them new house they didn't have a lot of money to build it. For first, they chose the design team which must to be able to realize a design proposal characterized by an high energy performance envelope and completed of high efficiency heating system plan. For this, they decided for:

- Architectural concept: M. SC. Dr. Arch. Barbara Wörndle in collaboration with Obrist&Partner
- Energy concept: Dr. Ing. Oscar Stuffer
- Thermal plants: P.I. Ruedl Michael

The available budget of Sirs. Pillon was not very high, so they decided to invest a lot of money in the efficiency of the buildings' envelope and saving money in the interior design of the furniture.

The owners wanted to define the work team for the design and realization phases. They chose different professionals (architect, engineers, constructor...) that is get to collaborate together to realize a high energy performance building. So this, was necessary to use an Integrated energy design process and manage and control the project during the whole developing process.

The new family building was been designed such as a single building, separated to the existent unused one. For this reason the wall adjacent to the neighbor was been realized with an important thickness of insulation (26 cm of EPS panels).

2008

Construction phase

The old part of a barn from ca. 1915 was demolished and rebuilt during 2008 for residential use.



2009

Utilization of the building

The building was built with passive house standard and certified with the local standard of energy consumption „CasaClima Oro”, which means a heating demand in relation to net area of 9.66 kWh/(m²a). As the building is attached to the existing building with its southwest façade it has less solar gains from this side. The roof ridge of the saddle roof is therefore southwest – northeast orientated.

October 2010 to April 2011 Monitoring of the House

Within the Enerbuild project the CasaClima Gold building “Pillon” in Caldaro, in South Tyrol was monitored. The single family house was monitored in detail with fixed installed monitoring instruments in a long-term monitoring-campaign. Energy consumptions were measured in terms of thermal energy with the help of three heat meters for measuring the thermal energy for heating, domestic hot water and geothermal energy deployment. Electric energy consumptions were measured fore different plant consumers as electric energy of the heat pump, the circulation pump for floor heating, the circulation pump of geothermal circuit, the ventilators of the ventilation machine and the total energy consumption of the building.


For more information: H. Mahlkecht, D. Exner, R. Lollini. ENERBUILD - Part B: Analysis of the monitoring data of Passive House “Pillon – Caldaro – Kaltern” Winter report 2011-2012. Eurac research, Institute for Renewable Energy

“Thermal energy consumption for heating was measured with 10,3kWh/m²a. The result is lower than the energy calculation for heating established (PHPP calculation 14kWh/m²a and CasaClima calculation 11kWh/m²a). Even when taking the normalization for the real heating degree days into account the consumption is lower than the calculation. This excellent result is due to the efficient utilization of the building whit conscious users, who are well informed about functioning of their passive house.

Thermal energy for domestic hot water preparation is quite stable during the winter period and merges from 150 kWh to 190 kWh/month (Report Winter 2010-2011 Page 23 of 25) which is a quite low consumption for a family with 5 members and therefrom three small children. The average consumption amounts to 42kWh/person/month.

The electric energy consumption shoed that the heat pump has the highest energy requirement of the compact machine. The heat pump reaches the maximum consumption in January with about 225 kWh/month, the other electric energy components of the plant consume about 37 kWh. In comparison to this amount the electric energy for lighting and household is a lot higher and amounts to 850 kWh/ month in average. This means that 81% of the electric energy is used for household and lighting and 19% for the building equipment.”

Monthly thermal energy consumption for heating and domestic hot water

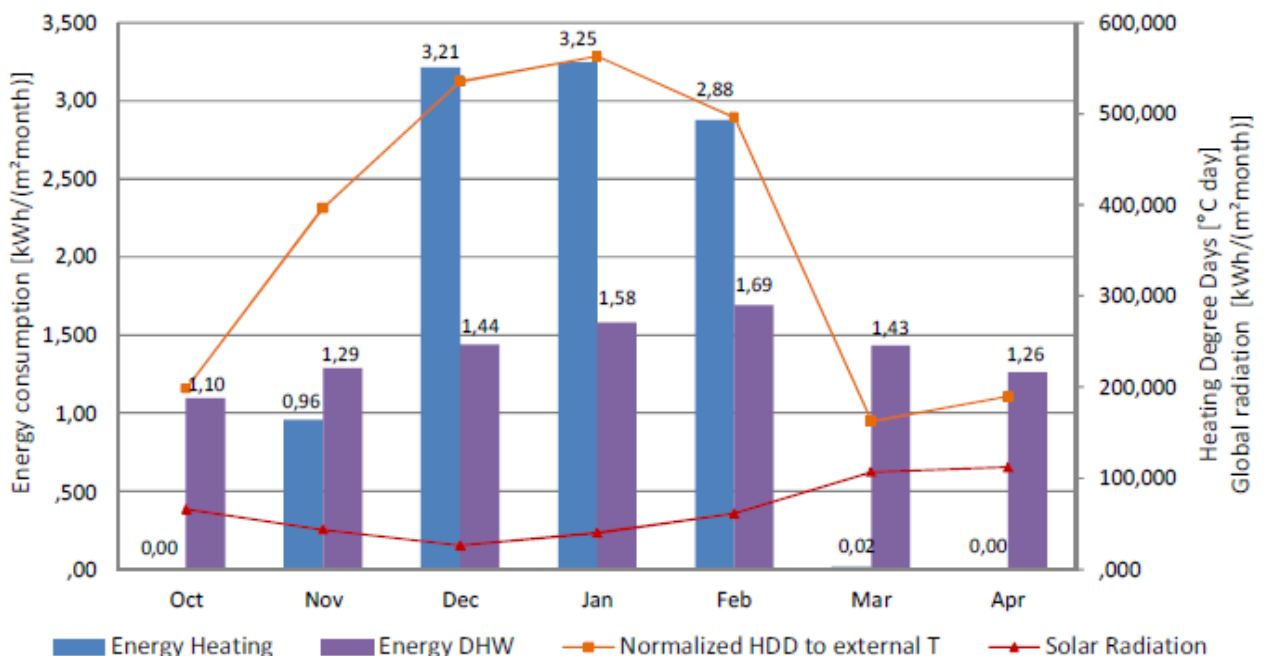

Graph1: Monthly Energy consumption for heating, domestic hot water, solar radiation and normalized heating degree days.

Notes: m² are referred to the treated floor area TFA, PHPP.

Comments: Thermal energy for heating was measured with 10,3kWh/m²a (PHPP calculation 14kWh/m²a and CasaClima calculation 10 kWh/m²a). Thermal energy for domestic hot water ranges from 150 kWh to 190 kWh a month. This gives an average value of about 2000 kWh/year. The average consumption amounts to 42kWh/person/month.